

Document Title	WECC Wind Power Plant Power Flow Modeling Guide
File Name	WECCWindPlantPowerFlowModelingGuide.pdf
Category	<input type="checkbox"/> Regional reliability standard <input type="checkbox"/> Regional criteria <input type="checkbox"/> Policy <input checked="" type="checkbox"/> Guideline <input type="checkbox"/> Report or other <input type="checkbox"/> Charter
Document date	May 19, 2010
Adopted/approved by	M&VWG
Date adopted/approved	May 2008
Custodian (entity responsible for maintenance and upkeep)	M&VWG
Stored/filed	Physical location: Web URL:
Previous name/number	Wind Generator Power Flow Modeling Guide .pdf
Status	<input checked="" type="checkbox"/> in effect <input type="checkbox"/> usable, minor formatting/editing required <input type="checkbox"/> modification needed <input type="checkbox"/> superceded by _____ <input type="checkbox"/> other _____ <input type="checkbox"/> obsolete/archived)

WECC Guideline:
WECC Wind Power Plant Power Flow Modeling Guide
Date: 5/2008

Introduction

This guideline provides guidance for aggregating wind power plants for power flow modeling.

Approved By:

Approving Committee, Entity or Person	Date
WECC Modeling and Validation Work Group	May 2008



**Western Electricity Coordinating Council
Modeling and Validation Work Group**

**WECC Wind Power Plant
Power Flow Modeling Guide**

**Prepared by
WECC Wind Generator Modeling Group**

May 2008

1. Introduction

This document contains technical recommendations for power flow representation of wind power plants (WPP) in the Western Electricity Coordinating Council (WECC), and was written by the WECC Wind Generation Modeling Group (WGMG). WGMG is also advancing the state of the art on WPP generic dynamic model implementation, and plans to produce dynamic representation guidelines for use in WECC. Those guidelines will be issued as a separate document.

2. Brief Background

2.1 Wind Power Plant Topology

A wind power plant (WPP) consists of many individual wind turbine generators (WTGs) tied to a medium voltage collector system, and connected to the transmission system at the interconnection point. Modern utility-scale WTGs have nameplate rating ranging from 1 MW to 4 MW. Terminal voltage is about 600 V. A step-up transformer, generally a pad-mounted unit, connects each WTG to a medium-voltage collector system operating at 12 kV to 34.5 kV. The collector system consists of one or several feeders connected together at a collector system station. One or more station transformers at the collector system station are used to achieve transmission system voltage. Unless the collector system station is adjacent to the interconnection point, an interconnection transmission line is needed. Reactive compensation in the form of mechanically switched capacitors and continuously variable devices such as STATCOMs or Static Var Systems (SVS) may be installed at the collector system station. Depending on the type of WTG, shunt reactive compensation at the WTG terminals may be installed for power factor correction. The amount and nature of reactive compensation is driven by interconnection requirements and collector system design considerations, including voltage regulation and losses. Figure 1 shows a typical WPP topology.

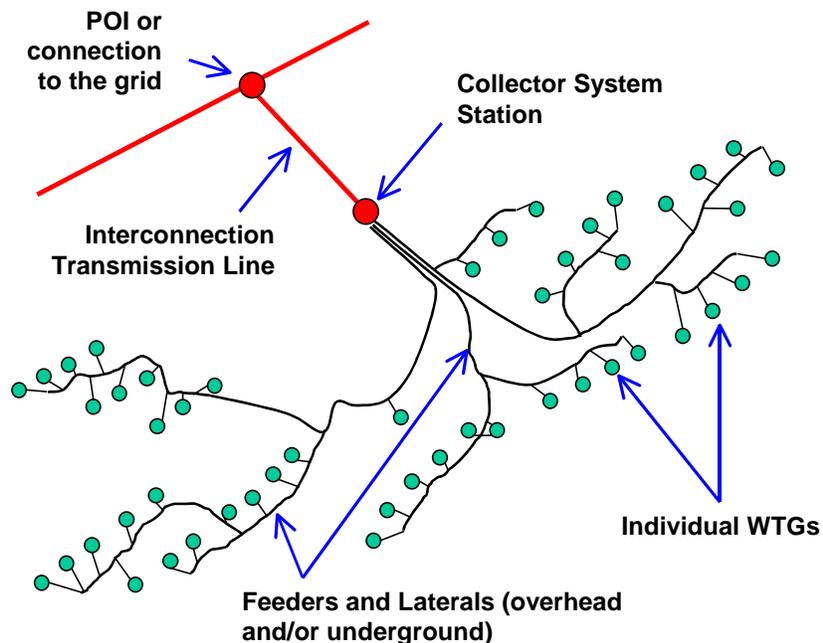


Figure 1. Wind Power Plant Topology

2.2 Types of Wind Turbine Generators

Early vintage WTGs were simple cage induction generators prone to tripping during grid disturbances. Until recently, tripping was considered preferable from the transmission system point of view, considering the small capacity of WPPs and their tendency to increase reactive power consumption and delay voltage recovery following electrical fault events. However, WPPs are becoming increasingly prominent in terms of size, especially in certain areas of the system. Also, they are located in sparsely populated windy areas, where the transmission system tends to be weak. Today, WPPs are expected to tolerate grid disturbances and contribute to overall power system reliability. In response to evolving wind generator interconnection standards, WTGs have improved rapidly with respect to steady-state and dynamic performance. WTG manufacturers have introduced numerous variations of electrical and mechanical controls as well as drive train and generator configuration. Most of modern WPPs have the ability to provide reactive power support to the system by using reactive capability built into the WTGs, or through external reactive compensation systems.

Despite the large variety of utility-scale WTGs available in the market, each can be classified into one of four basic types, based on the grid interface¹, as listed below:

- Type 1 – Cage rotor induction generators
- Type 2 – Induction generators with variable rotor resistance
- Type 3 – Doubly-fed asynchronous generators with rotor-side converter
- Type 4 – Full-power converter interface

The distinctive topological characteristics of each type are shown in Figure 2.

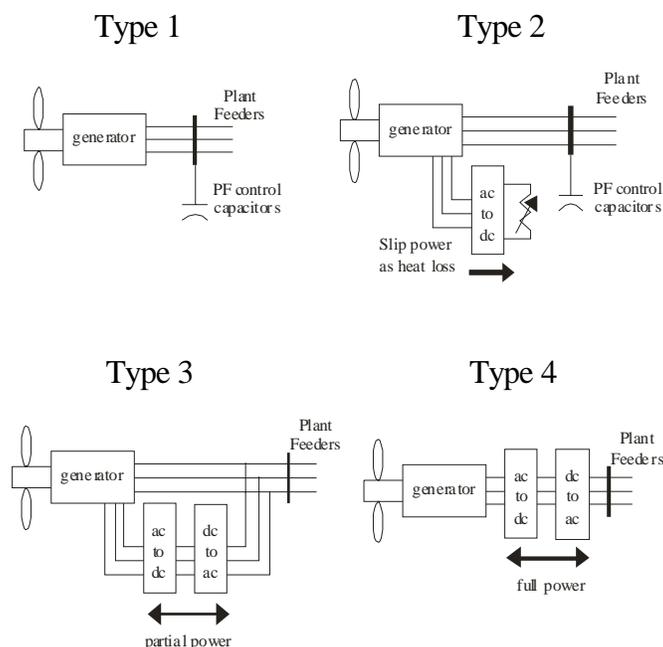


Figure 2 – Classification of WTGs Based on Generator Topology and Grid Interface

¹ Dynamic performance for each type of WTG is different. WGMG is working on WECC standard models for each.

3. Single-Machine Equivalent Representation

The WGMG recommends the use of the single-machine equivalent representation shown in Figure 3 to model WPPs in WECC base cases. Based on industry experience, this representation is also considered adequate for positive-sequence transient stability simulations.

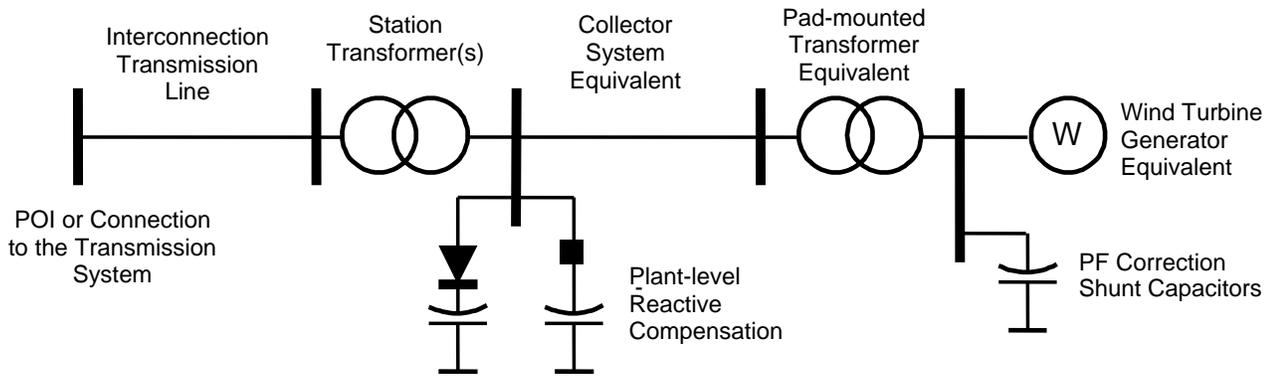


Figure 3: Single-Machine Equivalent Power Flow Representation

The interconnection transmission line, station transformer(s) and plant-level reactive compensation should be represented explicitly, according to established industry practice. Equivalent representations are needed for the collector system station and WTGs.

- The equivalent generator and associated power factor correction capacitors represents the total generating capacity and reactive compensation of all the WTGs in the WPP.
- The equivalent generator step-up transformer (pad-mounted transformer) represents the aggregate effect of all WTG step-up transformers
- The equivalent collector system branch represents the aggregate effect of the WPP collector system, and should approximate real power losses and voltage drop out to the “average” WTG in the WPP.

Established power flow modeling principles should be applied to WPP representation, although there are some differences that require especial attention. Single-machine equivalent model parameters can be derived from preliminary data. Appendix A contains a sample data request form that covers all the powerflow data needs. Preliminary data should be replaced with as-built data when such data becomes available, certainly shortly after commissioning. Powerflow model data should be validated from time to time by comparing the model to actual data, consistent with WECC and NERC requirements and methodologies. However, as of the date this guide was written, specific WPP testing and model validation guidelines have not been adopted for use in WECC.

With the proper model parameters, this model should approximate WPP powerflow characteristics at the interconnection point, collector system real and reactive losses and voltage profile at the terminals of the “average WTG” in the WPP. There are some limitations, however. Due to collector system effects, terminal voltage of individual WTGs could vary widely. WTGs that are closest to the interconnection point may experience significantly different terminal voltage compared to WTGs that are electrically farthest from the interconnection point. In actual operation, terminal voltage of some

WTGs may reach control or protection limits, resulting in different terminal behavior, or tripping. During the design stage, or in special circumstances, it may be reasonable to use a more detailed representation of the collector system. However this type of detail usually is not relevant for large-scale simulations.

The following guidelines should be considered to model each of the components of the WPP single-machine equivalent representation.

3.1 Interconnection Transmission Line

Standard data includes line voltage, line length, and line parameters (R, X and B). In some cases, the interconnection transmission line may be operated at a voltage level lower than the system voltage at the interconnection point, but higher than the collector system voltage. This requires an additional transformation stage and perhaps more shunt compensation to make up for higher reactive losses. Economics may favor this approach depending on a number of factors.

3.2 WPP Station Transformer

A WPP contains one or several station transformers at the collector system station. Station transformers should always be modeled explicitly. They represent the majority of the impedance between the interconnection point and the terminals of the equivalent WTG. Standard data includes transformer terminal voltage, MVA ratings (ONAN/FA/FA), percent impedance on the transformer's self-cooled (ONAN) MVA base, and X/R ratio. Positive-sequence impedance for these types of transformers is in the range of 7 to 10%, with X/R ratio in the range of 40 to 50.

3.3 Plant Level Reactive Compensation

Many WPPs have reactive compensation installed at collector system station, consisting of mechanically switched capacitors, continuously acting reactive power devices (such STATCOM or SVS). The plant-level reactive power compensation system can be controlled to meet one of three possible steady-state control objectives:

- **Closed-loop voltage control** - Maintain voltage schedule within the reactive power capability of the WPP, over a certain range of real power output. Controlling voltage at the interconnection point is likely to cause large reactive power swings for small voltage changes if the WPP is connected to a strong transmission system. Reactive droop compensation can be used to improve reactive power stability without compromising voltage control benefits. A small voltage hysteresis may be allowed in some situations. For instance, the requirement may be to regulate voltage at the interconnection point within 1% or 2% of schedule when WPP output exceeds 20% of rated capacity.
- **Power factor control** - Maintain power factor at the interconnection point close to a specified level. For instance, the requirement may be to maintain power factor between 0.98 lead and unity at the interconnection point.
- **Reactive power control** - Maintain reactive power flow within some specified limits. For instance, the requirement may be to limit reactive power flow at the interconnection point to 5 or 10 Mvar, in either direction.

Some WTGs have the capability to participate in steady-state voltage control and meet a portion or all the interconnection requirements. However, this capability is not always implemented in the field (see Section 3.6).

To properly model plant level reactive compensation, it is very important to establish what reactive control mode has been implemented, as well as the type of WTGs and compensation devices that are used. The following should be kept in mind to properly model reactive compensation devices:

- Discrete shunt capacitors should be modeled as constant impedance devices in power flow, to capture voltage-squared effects.
- Continuously variable reactive power devices such as STATCOMs should be modeled as a reactive power generator in power flow. Reactive limits should be set to the continuous rating of the device, consistent with power flow time frame. Some STATCOM manufacturers allow a transient overload capability in the 2 to 3 second time frame. This can be taken into account in dynamic simulations. However, the temporary overload capability should not be used in power flow.
- Ideally, SVCs should be represented as “svd” (static Var devices) with the appropriate number and size of steps. However, standard positive-sequence simulation programs require that this type of devices be represented as generators in power flow before conducting dynamic simulations. Therefore, it is recommended that SVCs be represented as generators in power flow to avoid having to convert a potentially large number of svd to generators in order to conduct dynamic simulations. Until this modeling issue is resolved, it is recommended that SVCs be represented as generators in power flow.

3.4 Equivalent Collector System

WPP collector systems consist of relatively long medium voltage feeders and laterals. Factors considered in feeder design include cost, real power losses, and voltage performance. A typical design goal is to keep average real power losses below 2%. At full output, real power losses can be higher, in the 3% to 5% range. Land use agreements usually favor the use of underground feeders despite the higher cost. For that reason, equivalent collector system X/R ratio tends to be low and line susceptance is high compared to typical overhead circuits. The equivalent collector system impedance also tends to be small compared to the station transformer impedance, but is not insignificant.

A simple method developed by NREL² can be used to derive equivalent impedance (Z_{eq}) and equivalent susceptance (B_{eq}) from conductor schedule as follows:

$$Z_{eq} = R_{eq} + jX_{eq} = \frac{\sum_{i=1}^I Z_i n_i^2}{N^2},$$

$$B_{eq} = \sum_{i=1}^I B_i,$$

² E. Muljadi, A. Ellis, et al, “Equivalencing the Collector System of a Large Wind Power Plant”, IEEE Power Engineering Society Annual Conference, Montreal, Quebec, June 12-16, 2006.

where I is total number of branches in the collector system, Z_i and n_i are the impedance ($R_i + jX_i$) for i^{th} branch, and N is the total number of WTGs in the WPP. As stated before, the equivalent impedance computed in this manner approximates real and reactive losses seen by the “average WTG” in the WPP. This calculation can be easily implemented in a spreadsheet. Figure 4 shows a simple example with $I = 21$, $N = 18$.

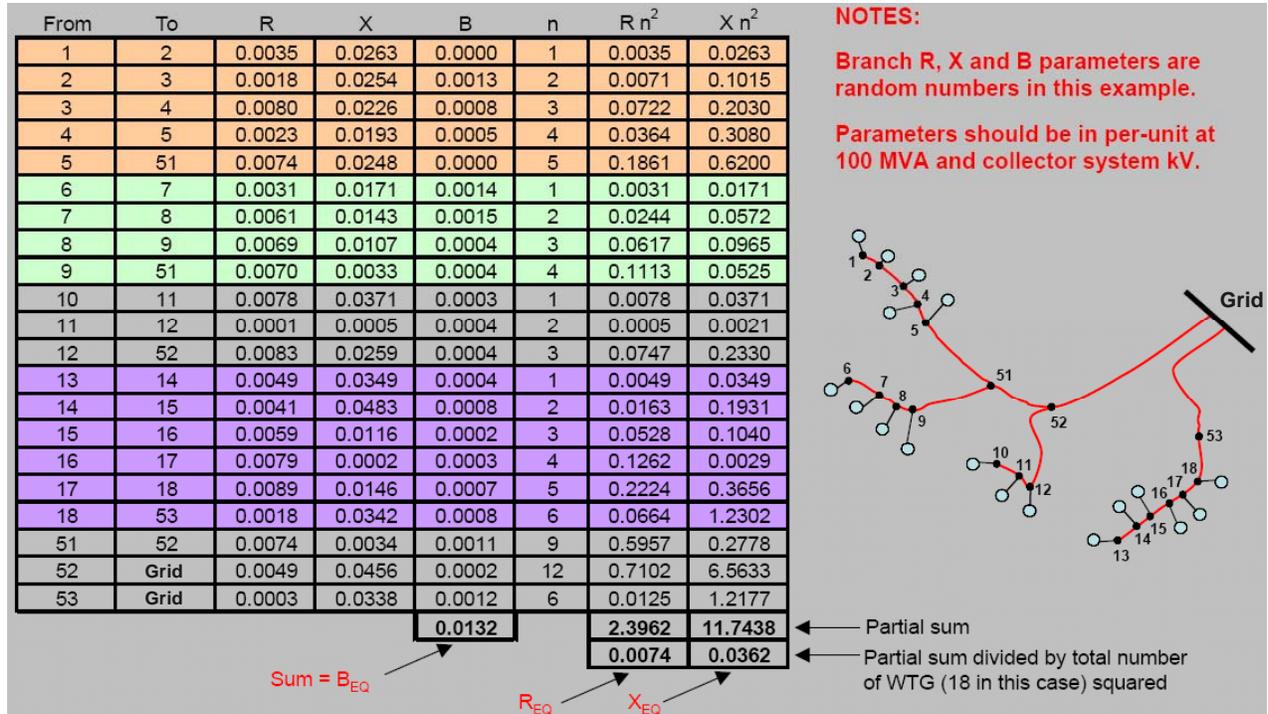


Figure 4 – Computation of Collector System Equivalent Parameters

Larger WPPs have lower Z_{eq} and higher B_{eq} considering that additional circuits are needed to handle larger currents. However, this relationship does not always hold. Table 1 shows some examples of actual equivalent collector system parameters for several WPP of different nameplate capacity and different collector system configuration. Per unit parameters are on a 100 MVA and collector system kV base.

Table 1 – Sample Equivalent Collector System Parameters

Plant size	Collector voltage	Feeder	R (pu)	X (pu)	B (pu)
100 MW	34.5 kV	All underground	0.017	0.014	0.030
100 MW	34.5 kV	33% overhead (carrying 100% of WTG)	0.018	0.079	0.030
110 MW	34.5 kV	All underground	0.012	0.011	0.036
200 MW	34.5 kV	Some overhead	0.007	0.025	0.055
200 MW	34.5 kV	25% overhead (carrying 50% of WTG)	0.010	0.039	0.099
300 MW	34.5 kV	Some overhead	0.005	0.020	0.085
300 MW	34.5 kV	Some overhead	0.006	0.026	0.150

Note: per unit parameters are on a 100 MVA base and collector system kV base.

3.5 Equivalent WTG Step Up or Pad-Mounted Transformer

WTG pad-mounted transformers are typically two-winding air-cooled transformers. The per-unit equivalent impedance (Z_{Teq}) and the equivalent MVA rating (MVA_{Teq}) for the N identical WTG step-up transformers, each of which has impedance Z_T on its own MVA base (MVA_T), are computed as follows:

$$Z_{Teq} = Z_T$$
$$MVA_{Teq} = N \times MVA_T$$

Step-up transformers associated with modern utility-scale WTGs (1 to 3 MVA) have impedance of approximately 6% on the transformer MVA base, with X/R ratio of about 8.

3.6 Equivalent WTG Representation

For power flow simulations, the equivalent WTG should be represented as a standard generator. Real power level and reactive power capability must be specified according to the guidelines below.

3.6.1 Active Output Level

Generator interconnection studies are typically conducted with the WPP at full output. At the discretion of the transmission planner, WPPs in the study area that are included in the base case can be assumed to be at full output, or at some other output level, depending on the purpose of the study. The following should be taken into account:

- For regional transmission planning studies, it is recommended that the power level be established based on the average output level during the time frame of interest, unless specific high or low wind output scenarios are of interest. This approach allows for consideration of realistic load and resources balance over the study area. Average output during a certain time frame varies depending on the location of the WPP. For example, in the US desert southwest, WPP output tends to be low (5% to 15% of nameplate capacity) during the during peak summer load hours due in part to temperature-related wind turbulence. Average output increases during the evening hours (off peak load periods), as turbulence decreases. Average output is significantly higher during the spring and winter and fall. In locations near the coast, wind resource may be driven by other factors such land-water temperature differential, resulting in very different seasonal output patterns.
- Due to the steepness of WTG power curve or output versus wind speed characteristic (see Figure 5), an individual WPP is likely to be at either low output (< 20% of nameplate capacity) or high output (> 80% of nameplate capacity) at any given time. Figure 6 shows an example of power output distribution for an individual WPP in the Pacific Northwest. This pattern tends to hold even for the aggregate output of wind farms that are in close proximity. Based on these observations may be reasonable to represent a WPP or group of WPPs installed in a certain region either off-line or at maximum power output. Again, the choice is dependent on the purpose of the study.

Additional investigation and operational experience is underway to reconcile the above observations and provide guidance for dispatching wind generation in WECC base cases.

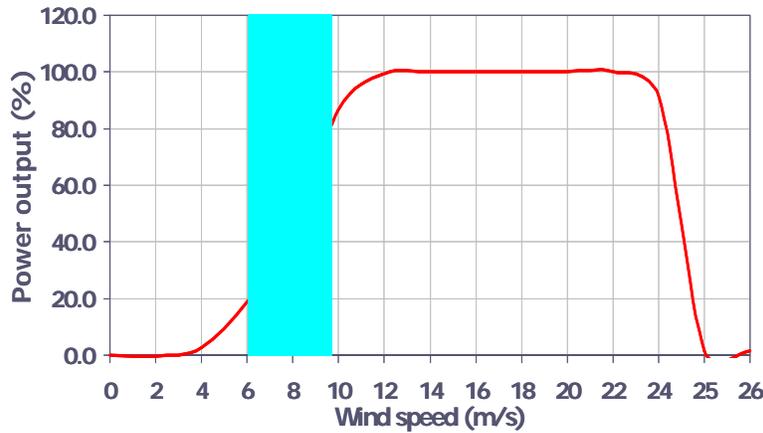


Figure 5 – Typical wind power curve (output versus wind speed)

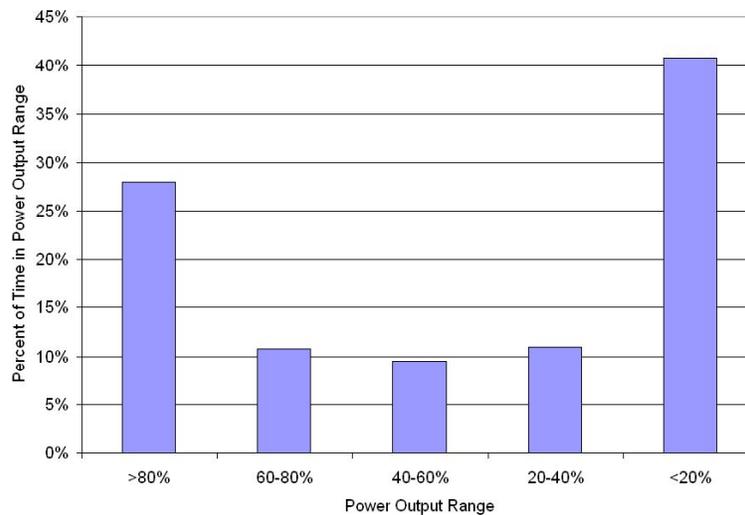


Figure 6 – Output distribution for a wind power plant in the Pacific Northwest

3.6.2 Reactive Power Capability and Power Factor Correction Capacitors

WTG reactive power capability is related to the type of WTG, as defined in Section 2.2, and the manner in which they are operated. The following guidelines apply:

- Type 1 and 2 WTGs are induction machines. In the range of 50% to 100% power level, uncompensated power factor typically ranges from 0.85 to 0.90 under-excited (consuming reactive power). Several stages of capacitors banks at the WTG terminals are normally applied to raise the power factor to approximately unity. In power flow, power factor correction capacitors should be modeled as fixed shunt devices, considering that that WPP power output is held constant in power flow studies. In the power flow model, reactive power consumption can be assumed to be ½ of the power output. A capacitor should be shown at the WTG terminals to compensate power factor to unity at nominal voltage. For example, for a 100 MW WPP at full output, both Q_{min} and Q_{max} would be set to -50 Mvar, and add a 50 Mvar shunt capacitor at the WTG terminals. Plant level reactive compensation may still be installed to meet interconnection requirements.

- Type 3 and Type 4 WTGs normally do not have power factor correction capacitors installed at the machine terminals. These WTGs are capable of adjusting power factor to a desired value within the rating of the generator and converter. They are also capable of voltage control at the interconnection point. When this functionality is implemented, the individual WTGs respond to a reactive power or power factor commands from an external plant-level controller. It should be kept in mind that, for commercial and other reasons, WTG-assisted steady-state voltage control functionality is not implemented or enabled in many WPPs with Type 3 or Type 4 WTGs. External reactive power compensation is often required to meet interconnection requirements, as discussed in Section 3.3. If these WTGs do not participate in voltage control, the equivalent generator should be assigned a fixed power factor, typically unity. (i.e., Q_{min} and Q_{max} would be set to 0). If the WTGs do participate in voltage control, then the equivalent generator should be assigned a reactive capability approximately equal to the aggregate WTG reactive power range. The WTG reactive power range is a function of power output. For example, consider a 100 MW WPP that employs Type 4 WTGs with specified power factor range +/-0.95 at full output. In this example, Q_{min} should be set to -33 Mvar and Q_{max} should be set to +33 Mvar. At an output level below rated, the reactive limits should be adjusted according to the WTG capability curve.

Due to collector system effects, some WTGs in the WPP will actually reach terminal voltage limits before reaching the nameplate reactive power limits. The net effect is that actual reactive power capability could be significantly less than the nameplate. The reactive power capability can be determined by field test or careful observation of WPP performance during abnormally high or low system voltage. For example, Figure 7 shows the results of field tests to determine the practical reactive limits of a 200 MW WPP. All measurements were made at the interconnection point. Taking into account the effect of transformer and collector system impedances, the reactive power limits of the equivalent WTG can be established. Currently, there are no industry standard guidelines for testing WPP steady-state reactive limits.

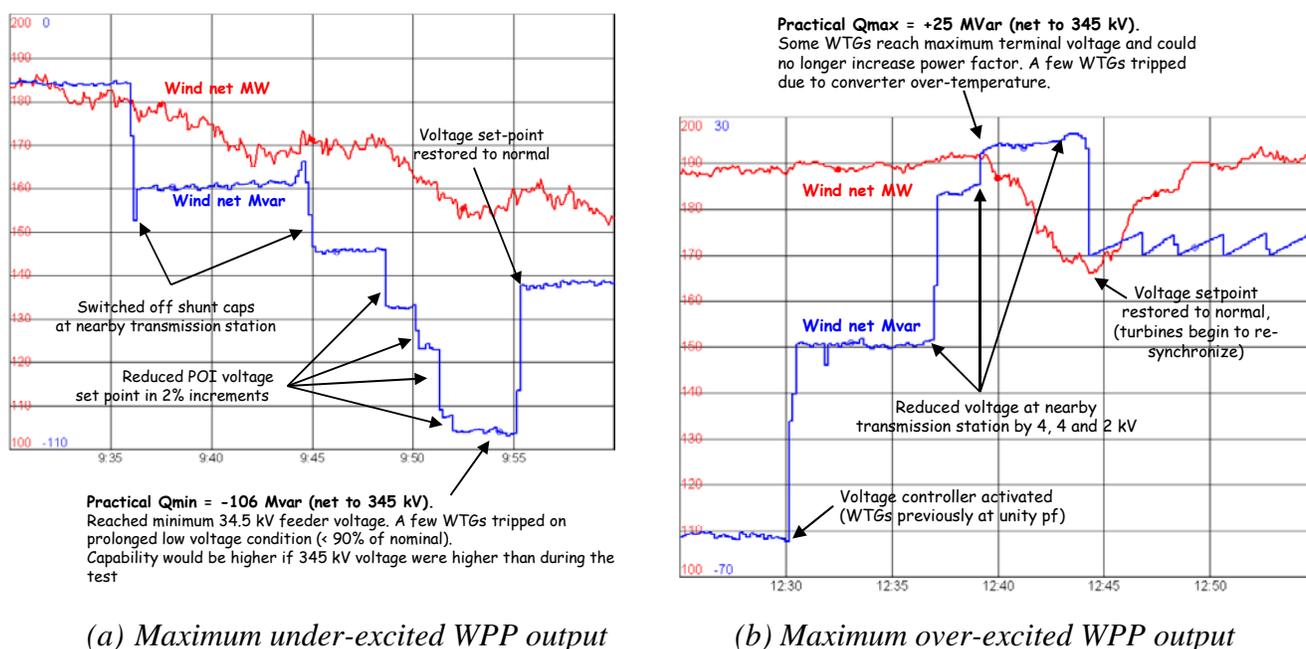


Figure 7 – Determination of Practical Reactive Power Limits by Field Test

4. Modeling during post transient and power flows

Modeling of WPP generator and reactive compensation components should be consistent with WECC pos-transient methodology. Control devices that can complete switching or operation within 3 minutes (e.g., SVCs, STATCOMS and shunts under automatic control) should not be blocked. Devices that require operator action should be blocked. The equivalent WPP generator should have the Load Flag set to “1” to reflect the fact that the output should not change during a governor power flow.

APPENDIX A SAMPLE DATA REQUEST FOR WIND POWER PLANTS

1. One-line Diagram. This should be similar to Figure 1 below.

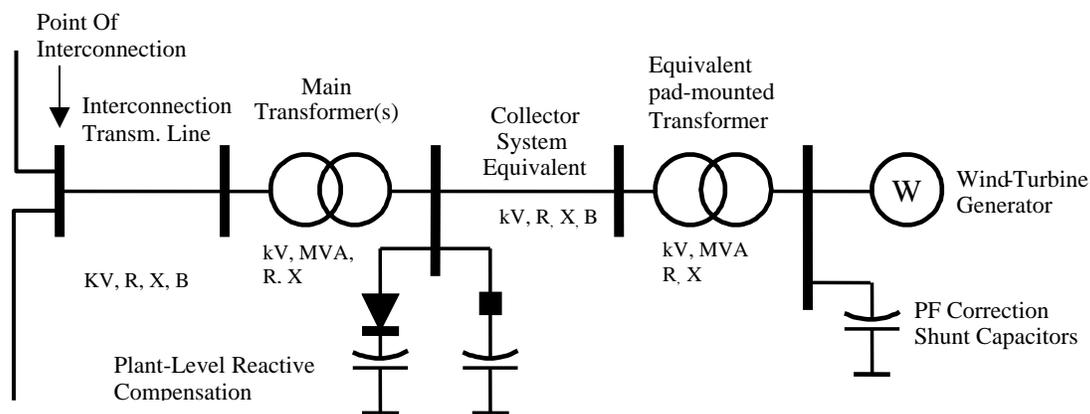


Figure A-1. Single-machine representation one-line diagram

2. Interconnection Transmission Line.

- Line voltage = _____ kV
- R = _____ ohm or _____ pu on 100 MVA and line kV base (positive sequence)
- X = _____ ohm or _____ pu on 100 MVA and line kV base (positive sequence)
- B = _____ uF or _____ pu on 100 MVA and line kV base

3. Station Transformer. (NOTE: If there are multiple transformers, data for each transformer should be provided)

- Rating (ONAN/FA/FA): _____/_____/_____ MVA
- Nominal Voltage for each winding (Low /High /Tertiary): _____/_____/_____ kV
- Winding Connections: _____/_____/_____ (Delta, Wye, Wye grounded)
- Available taps: _____ (indicated fixed or ULTC), operating Tap: _____
- Positive sequence Z: _____%, _____X/R on transformer self-cooled (ONAN) MVA
- Zero sequence Z: _____%, _____X/R on transformer self-cooled (ONAN) MVA

4. Collector System Equivalent Model. This can be found by applying the equivalencing methodology described in Section 3.4; otherwise, typical values can be used.

- Collector system voltage = _____ kV
- R = _____ ohm or _____ pu on 100 MVA and collector kV base
- X = _____ ohm or _____ pu on 100 MVA and collector kV base
- B = _____ mF or _____ pu on 100 MVA and collector kV base
- Attach a one-line diagram of the collector layout.

It is also acceptable to provide a complete collector system description similar to Figure 4 of the Power Flow Modeling Guide.

5. Wind-turbine Generator (WTG) Pad-Mounted Transformer. Note: These are typically two-winding air-cooled transformers. If the proposed project contains different types or sizes of pad-mounted transformers, please provide data for each type.

- Rating: _____ MVA
- Nominal voltage for each winding (Low /High): _____/_____kV
- Winding Connections: _____/_____ (Delta, Wye, Wye grounded)
- Available taps: _____ (please indicated fixed or ULTC), Operating Tap:_____
- Positive sequence impedance (Z1) _____%, _____X/R on transformer self-cooled MVA
- Zero sequence impedance (Z0) _____%, _____X/R on transformer self-cooled MVA

6. WTG Powerflow Data. Proposed projects may include one or more WTG Types (See NOTE 1 below). Please provide the following information for each:

- Number of WTGs: _____
- Nameplate rating (each WTG): _____ MW
- WTG Manufacturer and Model: _____
- WTG Type: _____

For Type 1 or Type 2 WTGs:

- Uncompensated power factor at full load: _____
- Power factor correction capacitors at full load: _____Mvar
- Number of shunt stages and size _____
- Please attach capability curve describing reactive power or power factor range from 0 to full output, including the effect of shunt compensation.

For Type 3 and Type 3 WTGs:

- Maximum under-excited power factor at full load: _____
- Maximum under-excited power factor at full load: _____
- Control mode: _____ (voltage control, fixed power factor) (See Note 7.2)
- Please attach capability curve describing reactive power or power factor range from 0 to full output.

NOTE 7.1: WTG Type can be one of the following:

- Type 1 – Squirrel-cage induction generator
- Type 2 – Wound rotor induction machine with variable rotor resistance
- Type 3 – Doubly-fed asynchronous generator
- Type 4 – Full converter interface

NOTE 7.2: Type 1 and Type 2 WTGs typically operate on **fixed power factor** mode for a wide range of output level, aided by turbine-side power factor correction capacitors (shunt compensation). With a suitable plant-level controller, Type 3 and Type 4 WTGs may be capable of dynamically varying power factor to contribute to **voltage control** mode operation, if required by the utility. However, this feature is not always available due to commercial and other reasons. The data requested must reflect the WTG capability that can be used in practice. Please consult with the manufacturer when in doubt. The interconnection study will determine the voltage control requirements for the project. Plant-level reactive compensation requirements are engineered to meet specific requirements. WTG reactive capability data described above could significantly impact study results and plant-level reactive compensation requirements.

7. Wind Farm Reactive Power Compensation. Provide the following information for wind farm-level reactive compensation, if applicable:

- Individual shunt capacitor and size of each: _____X_____ MVA
- Dynamic reactive control device, (SVC, STATCOM): _____
- Control range _____ Mvar (lead and lag)
- Control mode (line drop, voltage droop, voltage control): _____
- Regulation point _____
- Describe the overall reactive power control strategy:

8. Wind-turbine Generator (WTG) Dynamic Data. Model and parameter data required for transient stability analysis is specific to each WTG make and model. The dynamic models must be in an approved WECC format, or in a PSSE or PSLF format that is acceptable to the transmission provider. We strongly suggest that the manufacturers provide this information.

- Library model name: _____
- Model type (standard library or user-written): _____
- Model access (proprietary or non-proprietary): _____
- Attach full model description and parameter data